




高野公民館
西田公民館高野分館

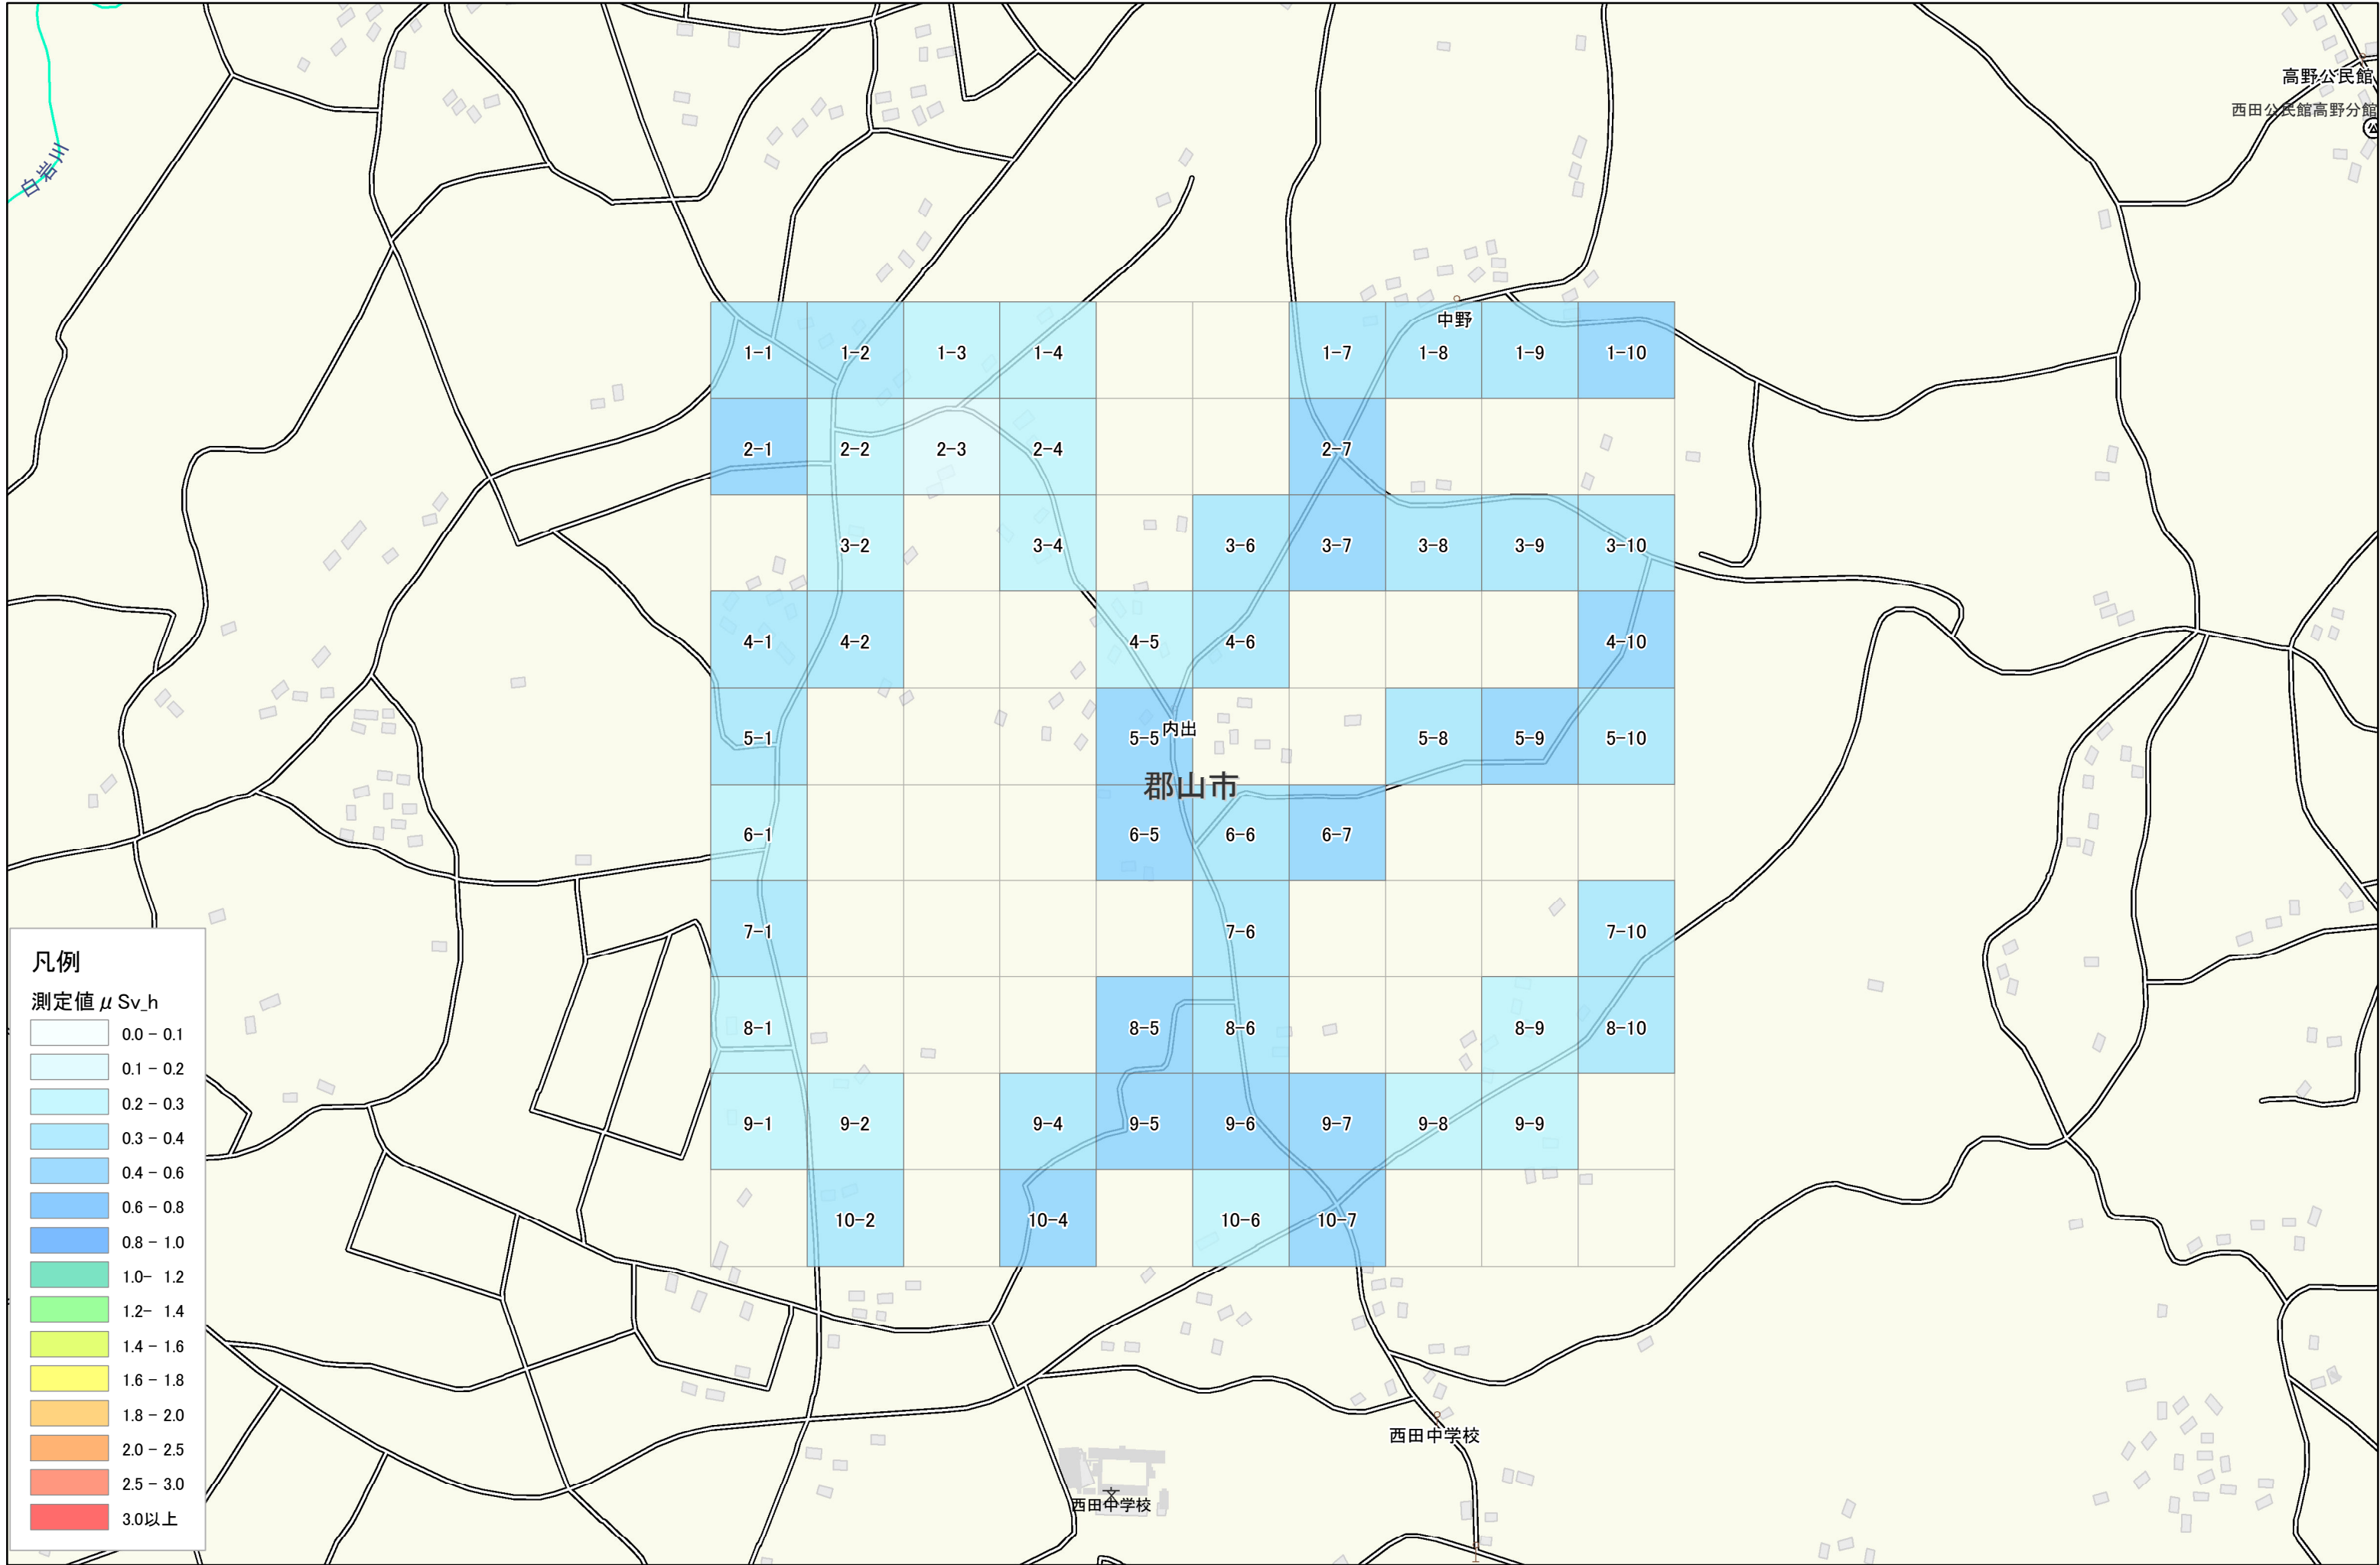

凡例

測定値 $\mu\text{Sv/h}$

0.0 - 0.1
0.1 - 0.2
0.2 - 0.3
0.3 - 0.4
0.4 - 0.6
0.6 - 0.8
0.8 - 1.0
1.0 - 1.2
1.2 - 1.4
1.4 - 1.6
1.6 - 1.8
1.8 - 2.0
2.0 - 2.5
2.5 - 3.0
3.0以上

1-1	1-2	1-3	1-4		1-7	中野 1-8	1-9	1-10	
2-1	2-2	2-3	2-4		2-7				
	3-2		3-4		3-6	3-7	3-8	3-9	3-10
4-1	4-2		4-5	4-6				4-10	
5-1			5-5 内出			5-8	5-9	5-10	
6-1			郡山市	6-5	6-6	6-7			
7-1				7-6				7-10	
8-1			8-5	8-6			8-9	8-10	
9-1	9-2		9-4	9-5	9-6	9-7	9-8	9-9	
	10-2		10-4		10-6	10-7			

西田中学校
西田中学校